

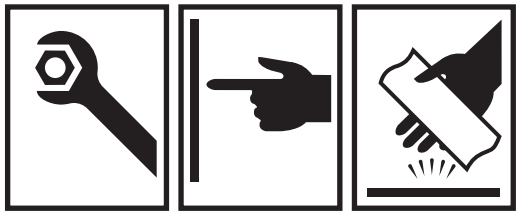
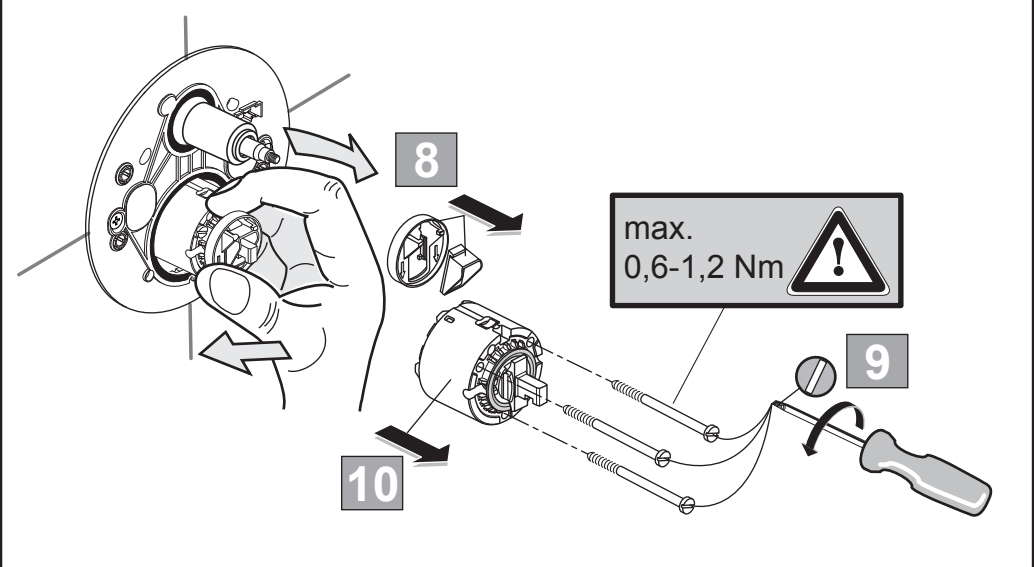
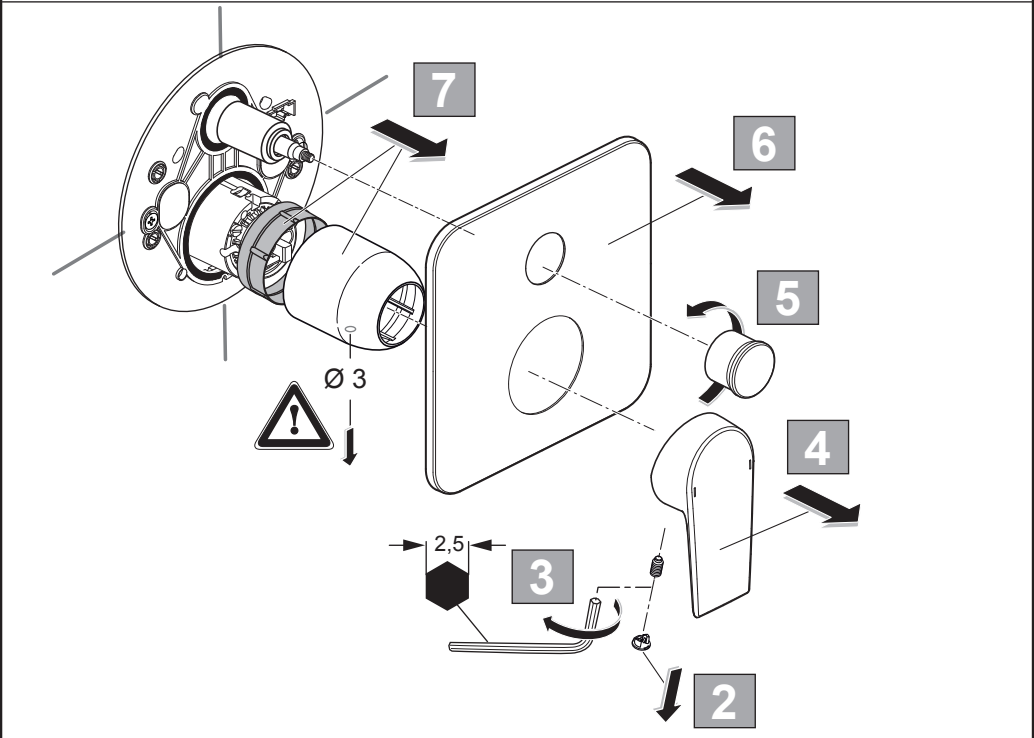


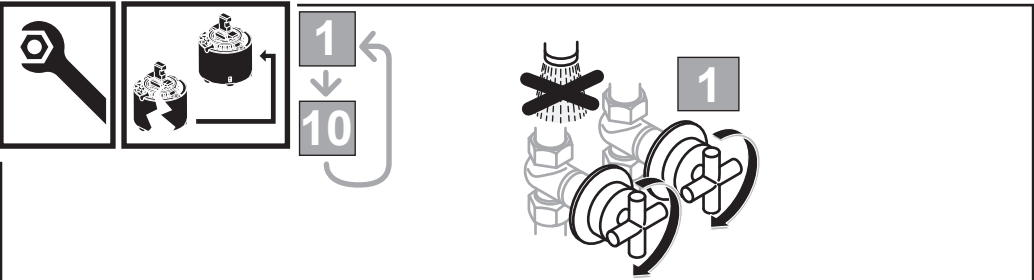


Spare Parts / Ersatzteile / Pièces de recharge / Pezzi di Ricambio / Piezas de requesto /
Parte de reposição / Reserveonderdelen / Reservdelar / Reservedeler / Varaosat /
Vraosat / Varahlutir / Ανταλλακτικά / Yedek Parçalar / Náhradní díly / Náhradné diely /
Nadomestni deli / Резервни части / Запчасти / Części Zapasowe / Piese de schimb
/ Rendelhető alkatrészek / Запасні частини / Reservni delovi / Резервни делови /
Резервни делови / Atsarginių dalių / Tellitavad varuosad / Rezervju daļu

1	A 963 131 NU	1 Set
4	A 963 132 NU	1 Set
8	A 963 143 NU	1 Set
9	A 963 146 NU	1 Set
10	A 963 147 NU	1 pcs
14	A 960 890 NU	1 Set
16	A 960 891 NU	1 pcs
17	A 960 706 NU	2 pcs
18	A 963 443 NU	1 pcs
20	A 960 500 NU	1 Set
21	A 963 335 NU	3 pcs
22	A 860 700 NU	1 Set
23	A 960 893 AA	1 Set
25	A 860 902 AA	1 pcs
26	A 860 897 NU	1 Set
27	A 860 900 AA	1 pcs
28	A 860 901 AA	1 pcs
29	A 963 309 NU	1 pcs
30	B 960 473 AA	1 pcs
31	A 860 896 AA	1 Set
32	A 960 704 NU	1 Set
	A 962 476 NU	1 Set

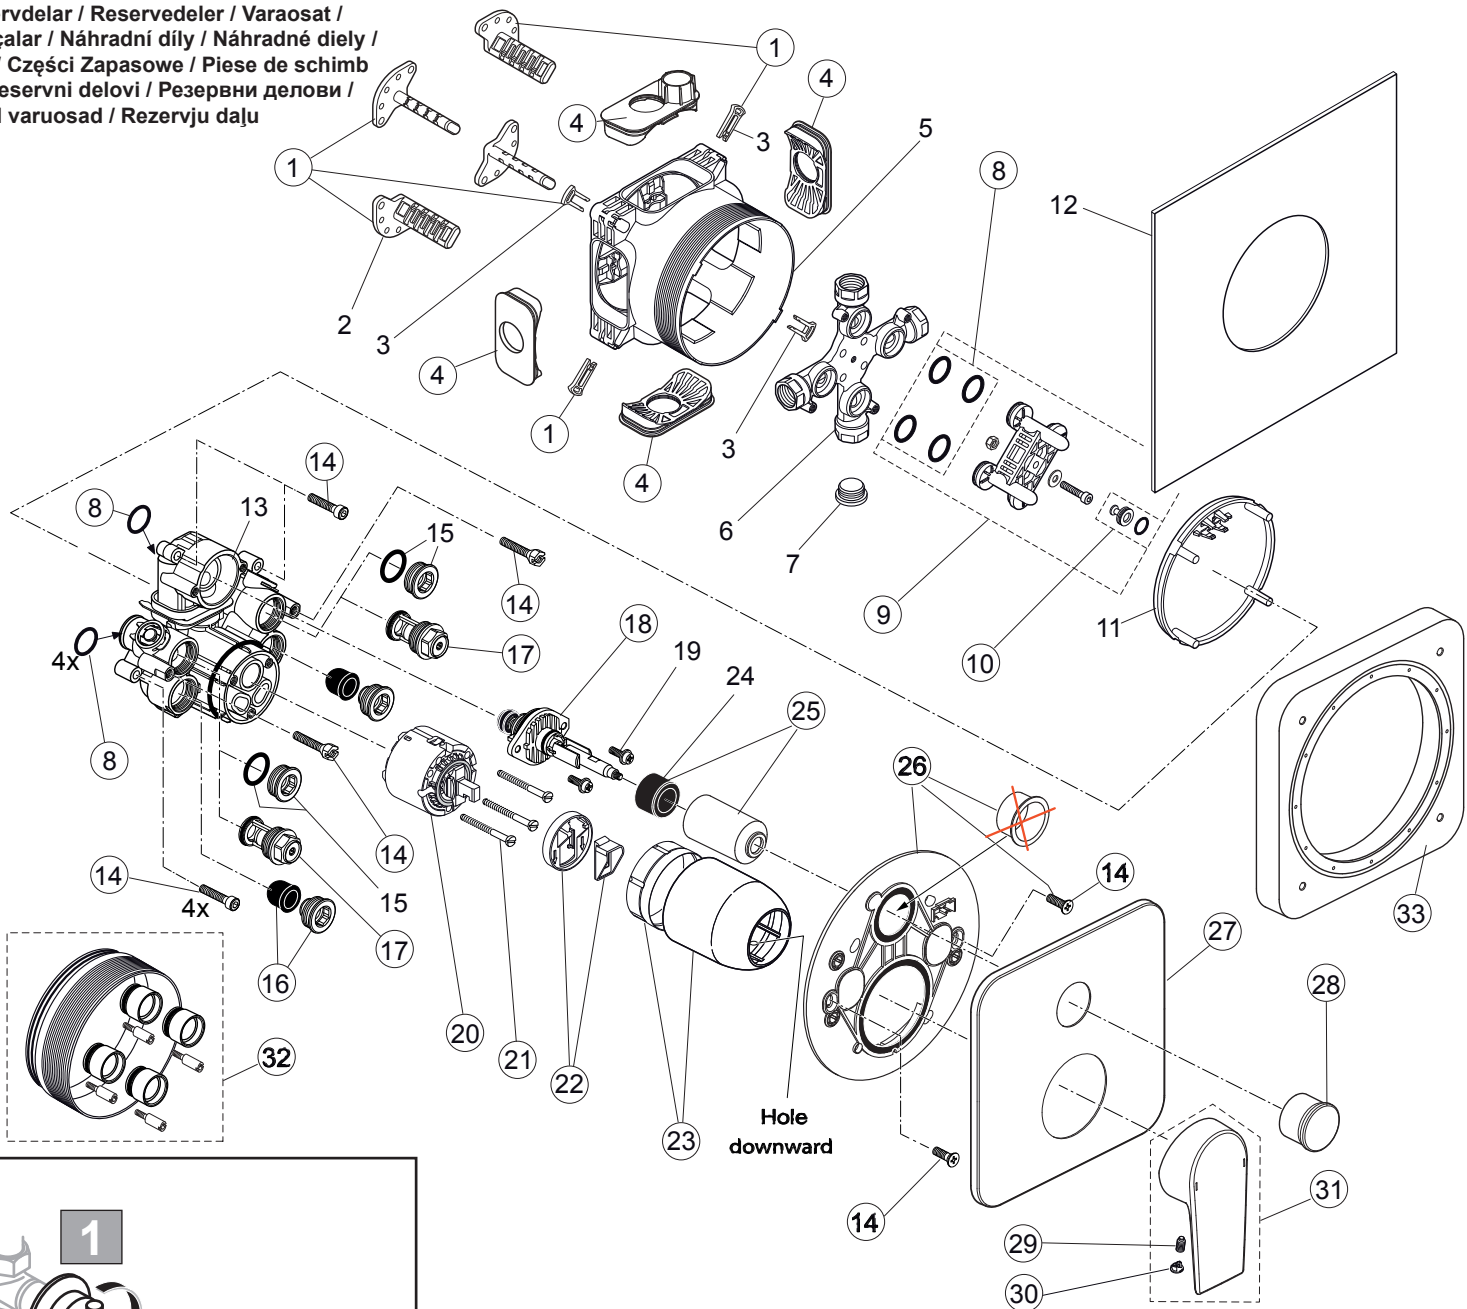


Tesi
A 6586 ...









1116 / A 868 159
(+ A 865 612)
Made in Germany

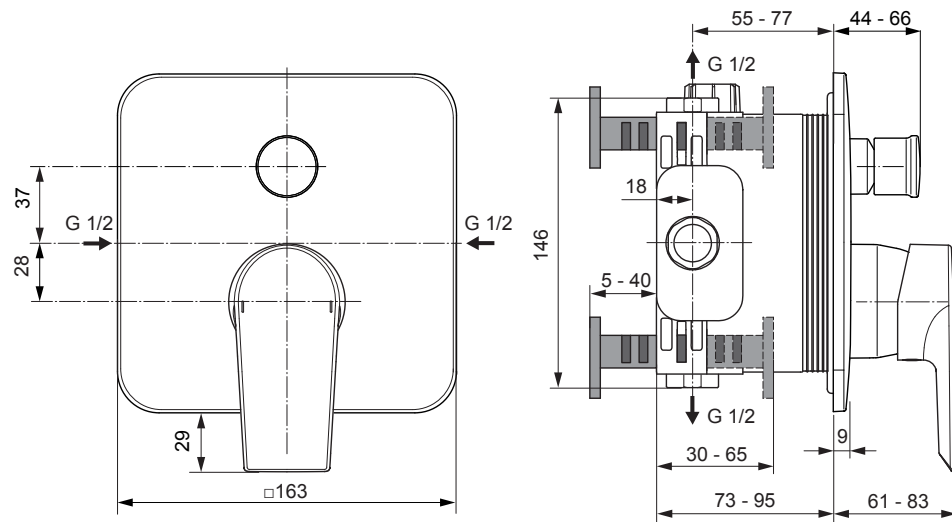


Ideal Standard International NV
Corporate Village - Gent Building
Da Vincilaan 2
1935 Zaventem
Belgium

www.idealstandardinternational.com



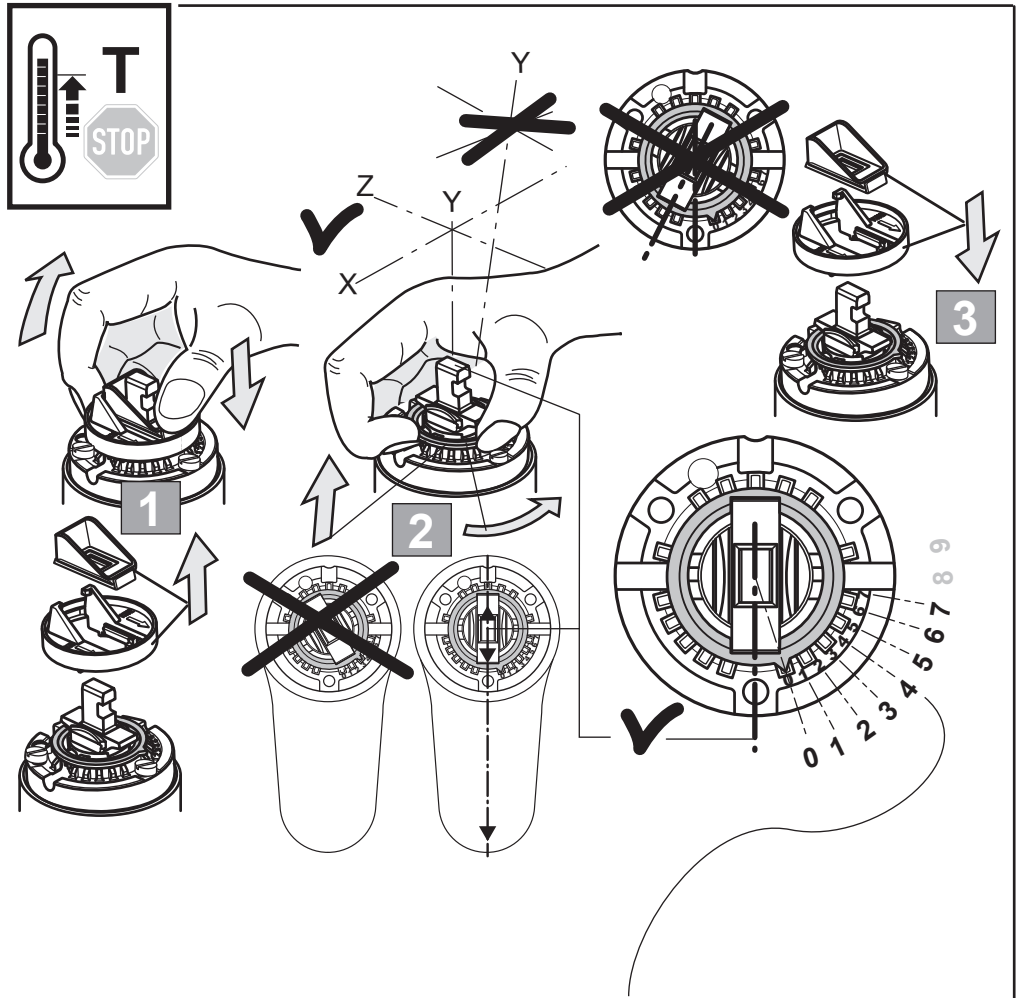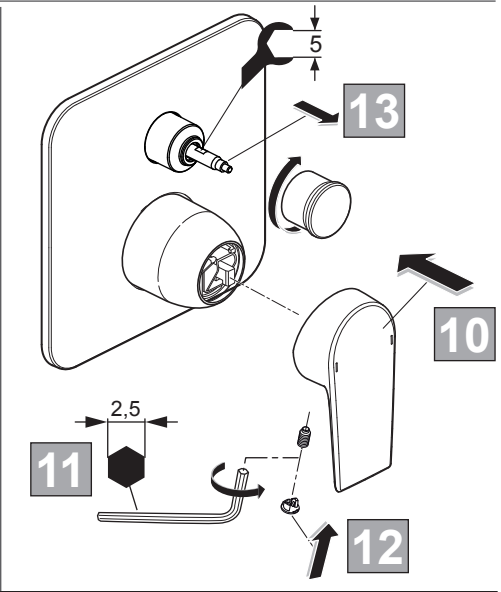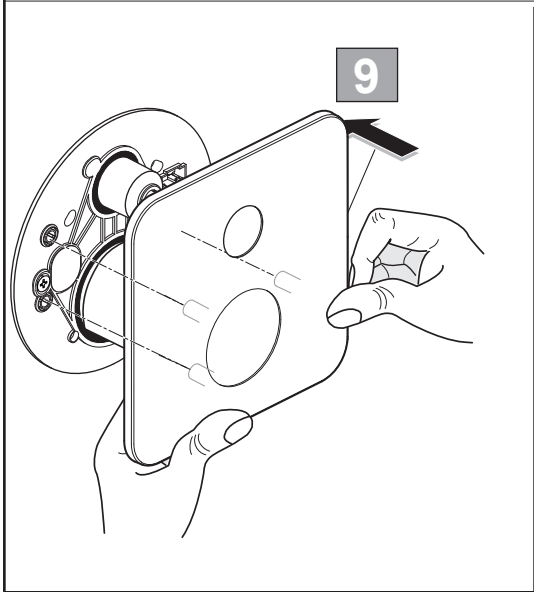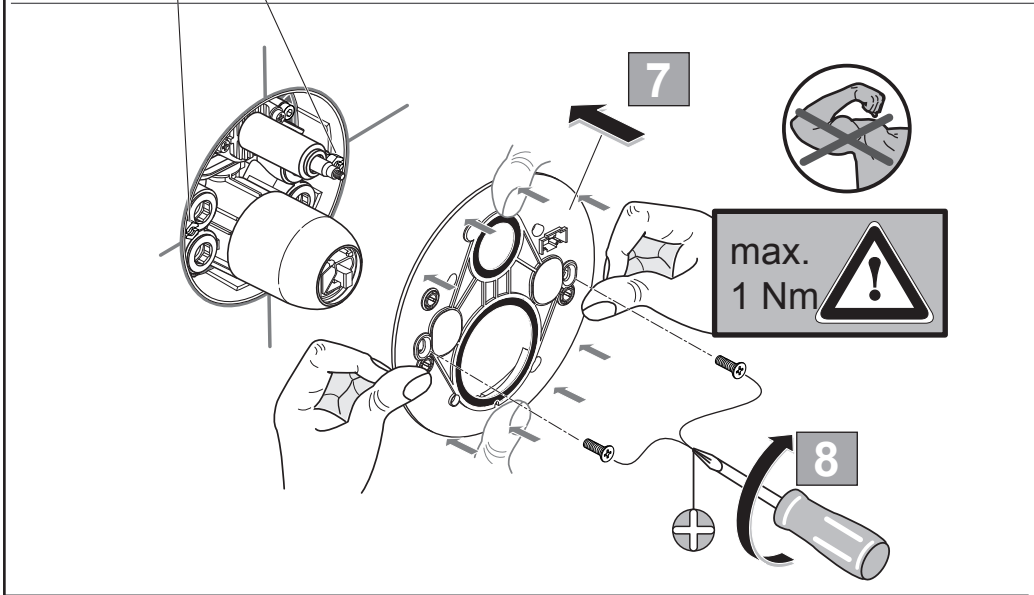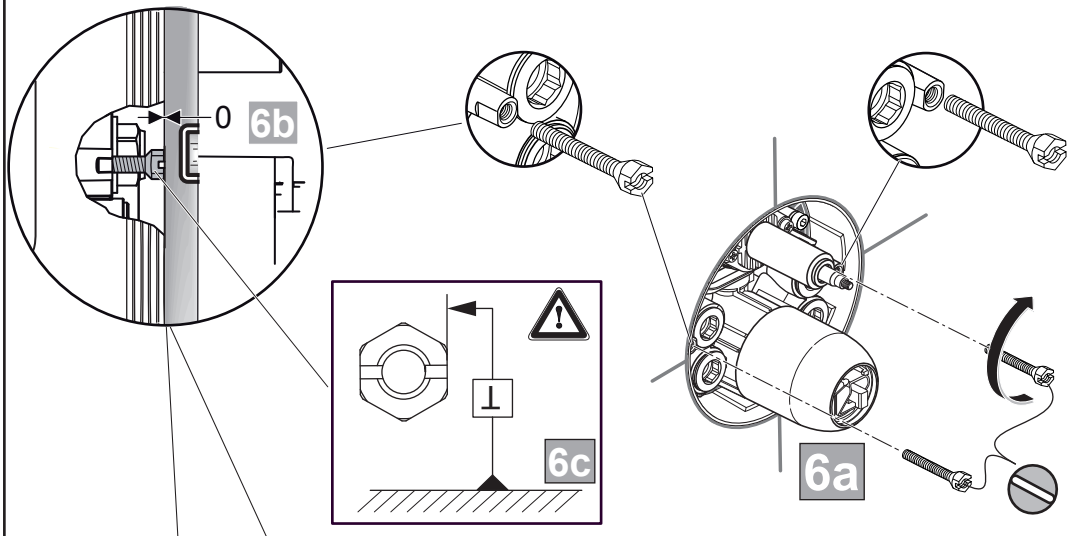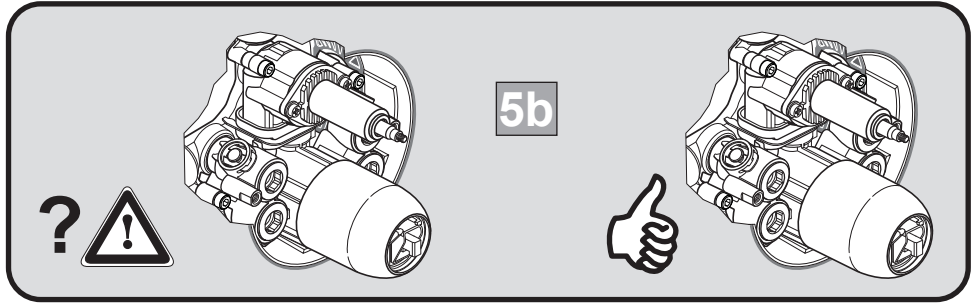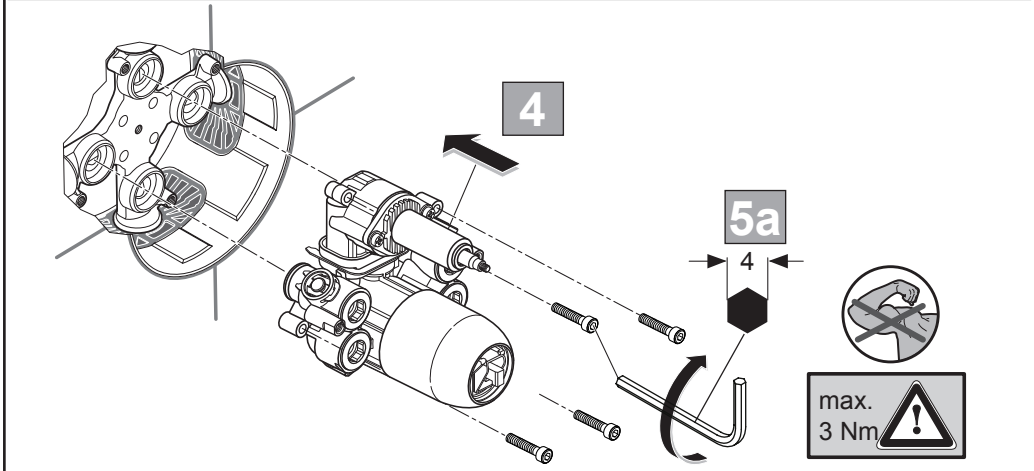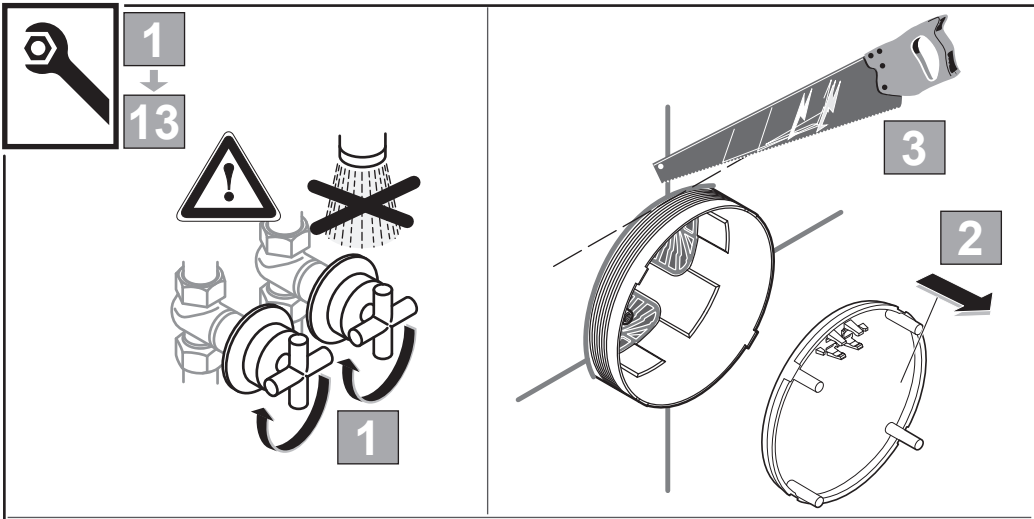

			0	1	2	3	4	5	6	7	8	9
			°C	°C	°C	°C	°C	°C	°C	°C	°C	°C
0,3 MPa 3 bar	50°C	16°C	49,5	49,5	48	46	42,5	41	37	33,5	31	28
	65°C	16°C	65	65	63,5	60,5	57	53,5	49	44,5	39	34,5
	81°C	16°C	81	81	78,5	73	69	63,5	56	49	42,5	36

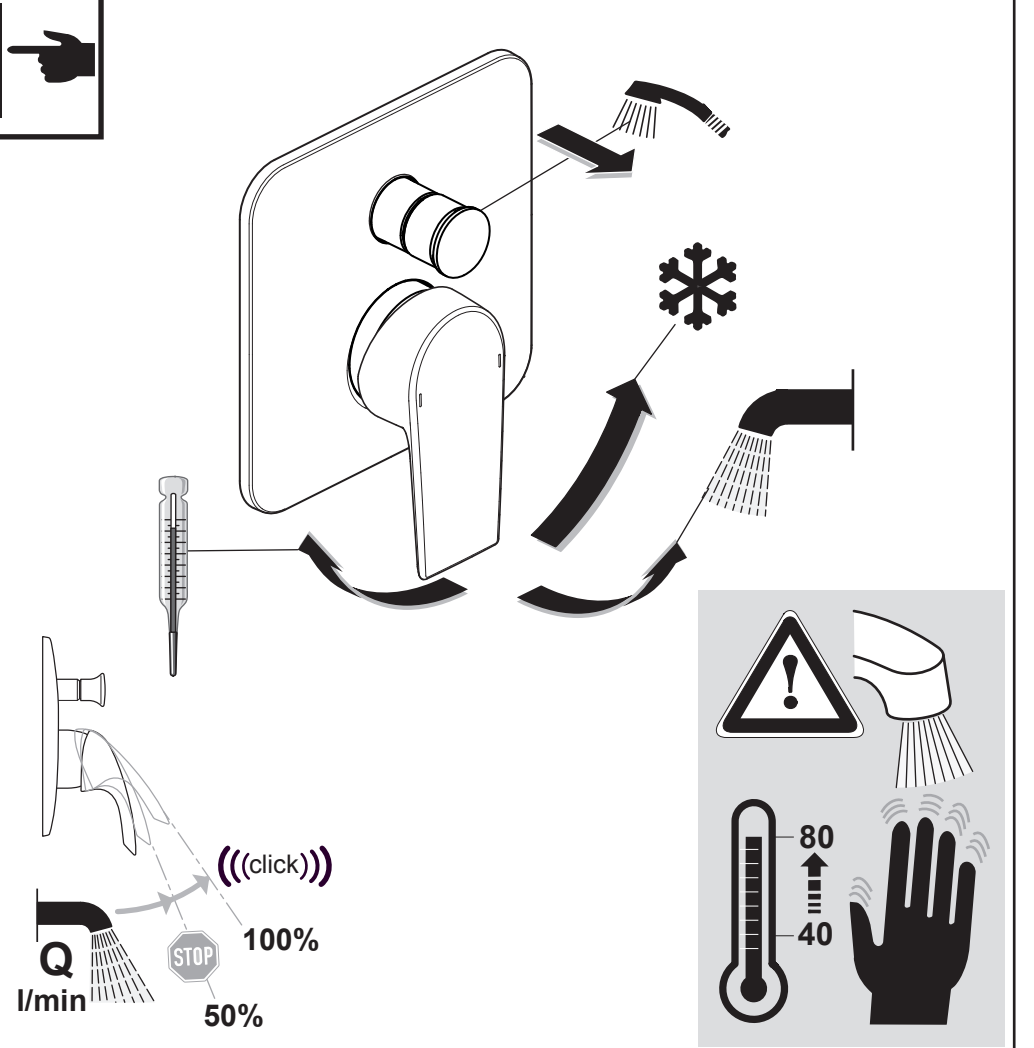

P	bar	MAX. 10	5	Q (3 bar)
T	°C	MAX. 80	65	I/min
			40	25